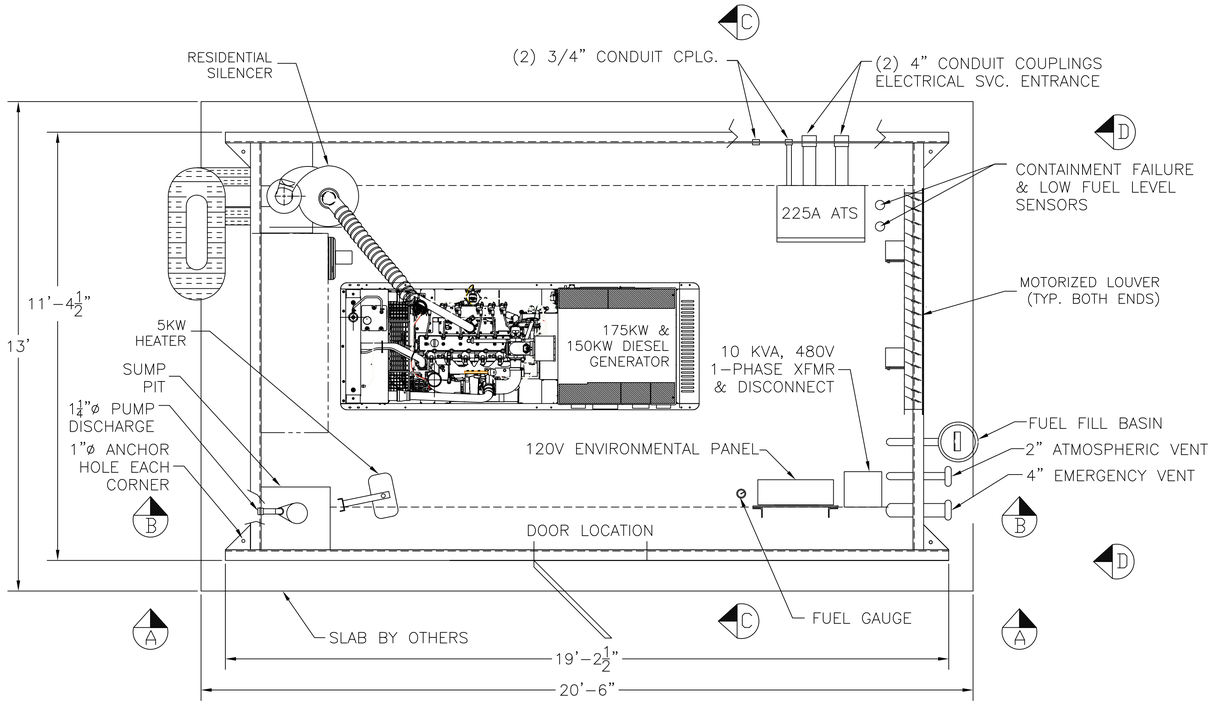

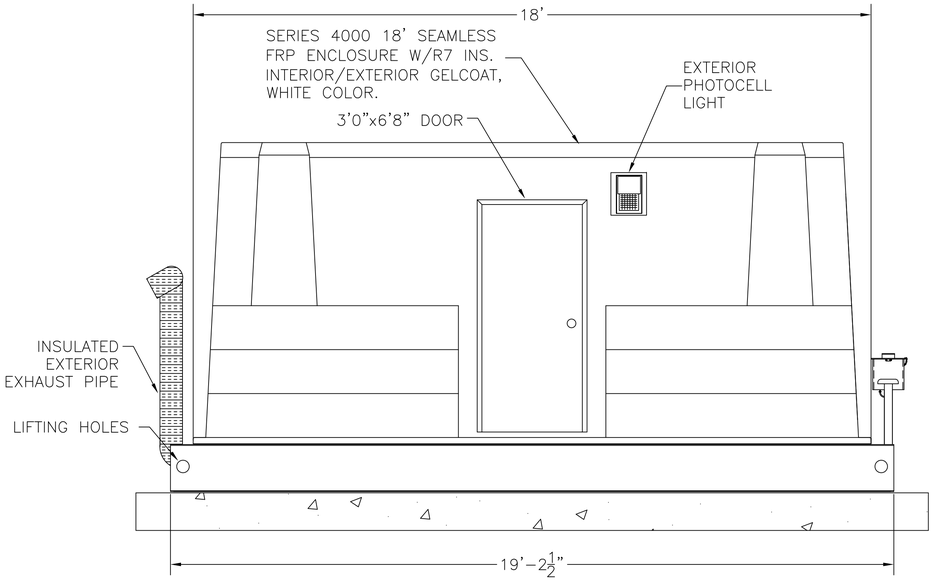

VIEW A-A

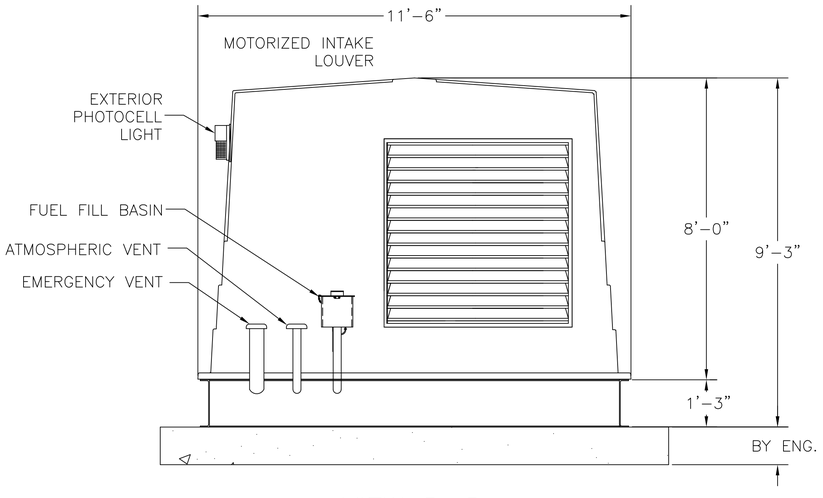

VIEW D-D

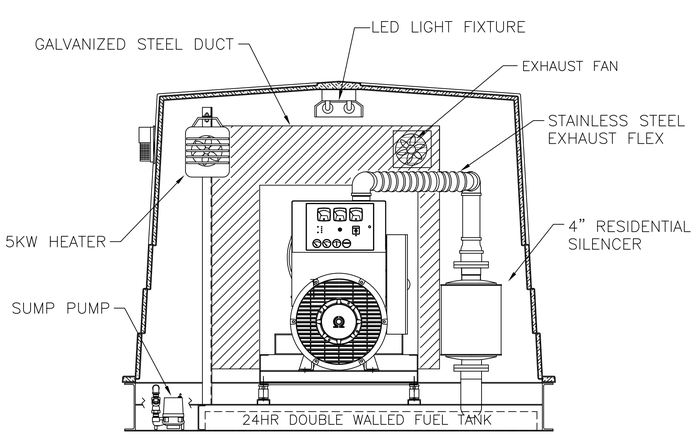

SECTION C-C

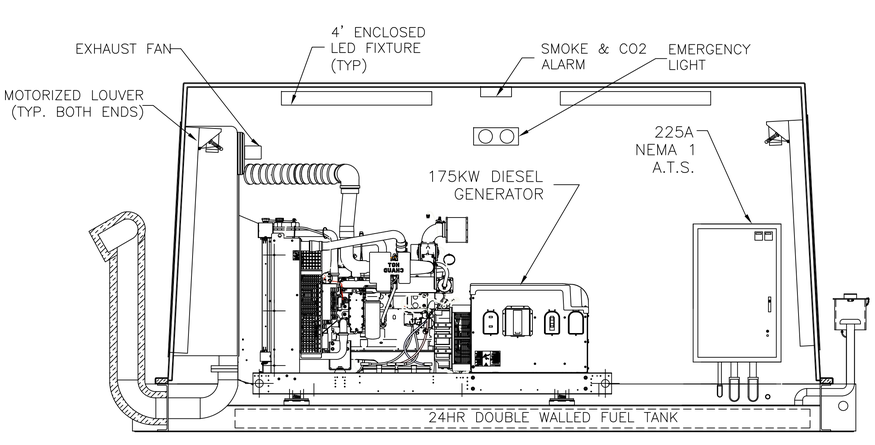

SECTION B-B

SITE UTILITY REQUIREMENTS

ELECTRICAL SERVICE

AMPERAGE	
VOLTAGE	480Y/277
PHASE	3
WIRE	4
CYCLE	60

DIESEL FILL SERVICE

(175 KW) - 125HP PUMP	
TANK VOLUME- GAL	320
GALLON PER HR.	13.3
(150 KW) - 100HP PUMP	
TANK VOLUME- GAL	300
GALLON PER HR.	11.7

NOTE: INSTALLING CONTRACTOR IS RESPONSIBLE FOR SUPPLYING FUEL TO COMPLETE STARTUP.

Rev	Description	By	Date

Dwg:	Dsn:	Chk:	Dwg. Filename:
AAS	PS	BAD	CO_ALAMOSA_WIS4018D

WATER WELL BACKUP DIESEL GENERATORS
ALAMOSA, CO

POWER PAC SERIES 4000-18' WALKIN
EQUIPMENT DETAIL

Job Number:	Date:	Scale:	Sheet:
22-041	01/12/23	NONE	1 of 1

PRECISION SYSTEMS
1530 HUNTINGTON DR.
CALUMET CITY, IL 60409
PH: (708) 891-4300
FAX: (708) 891-4401